Basic Hydronic Underfloor
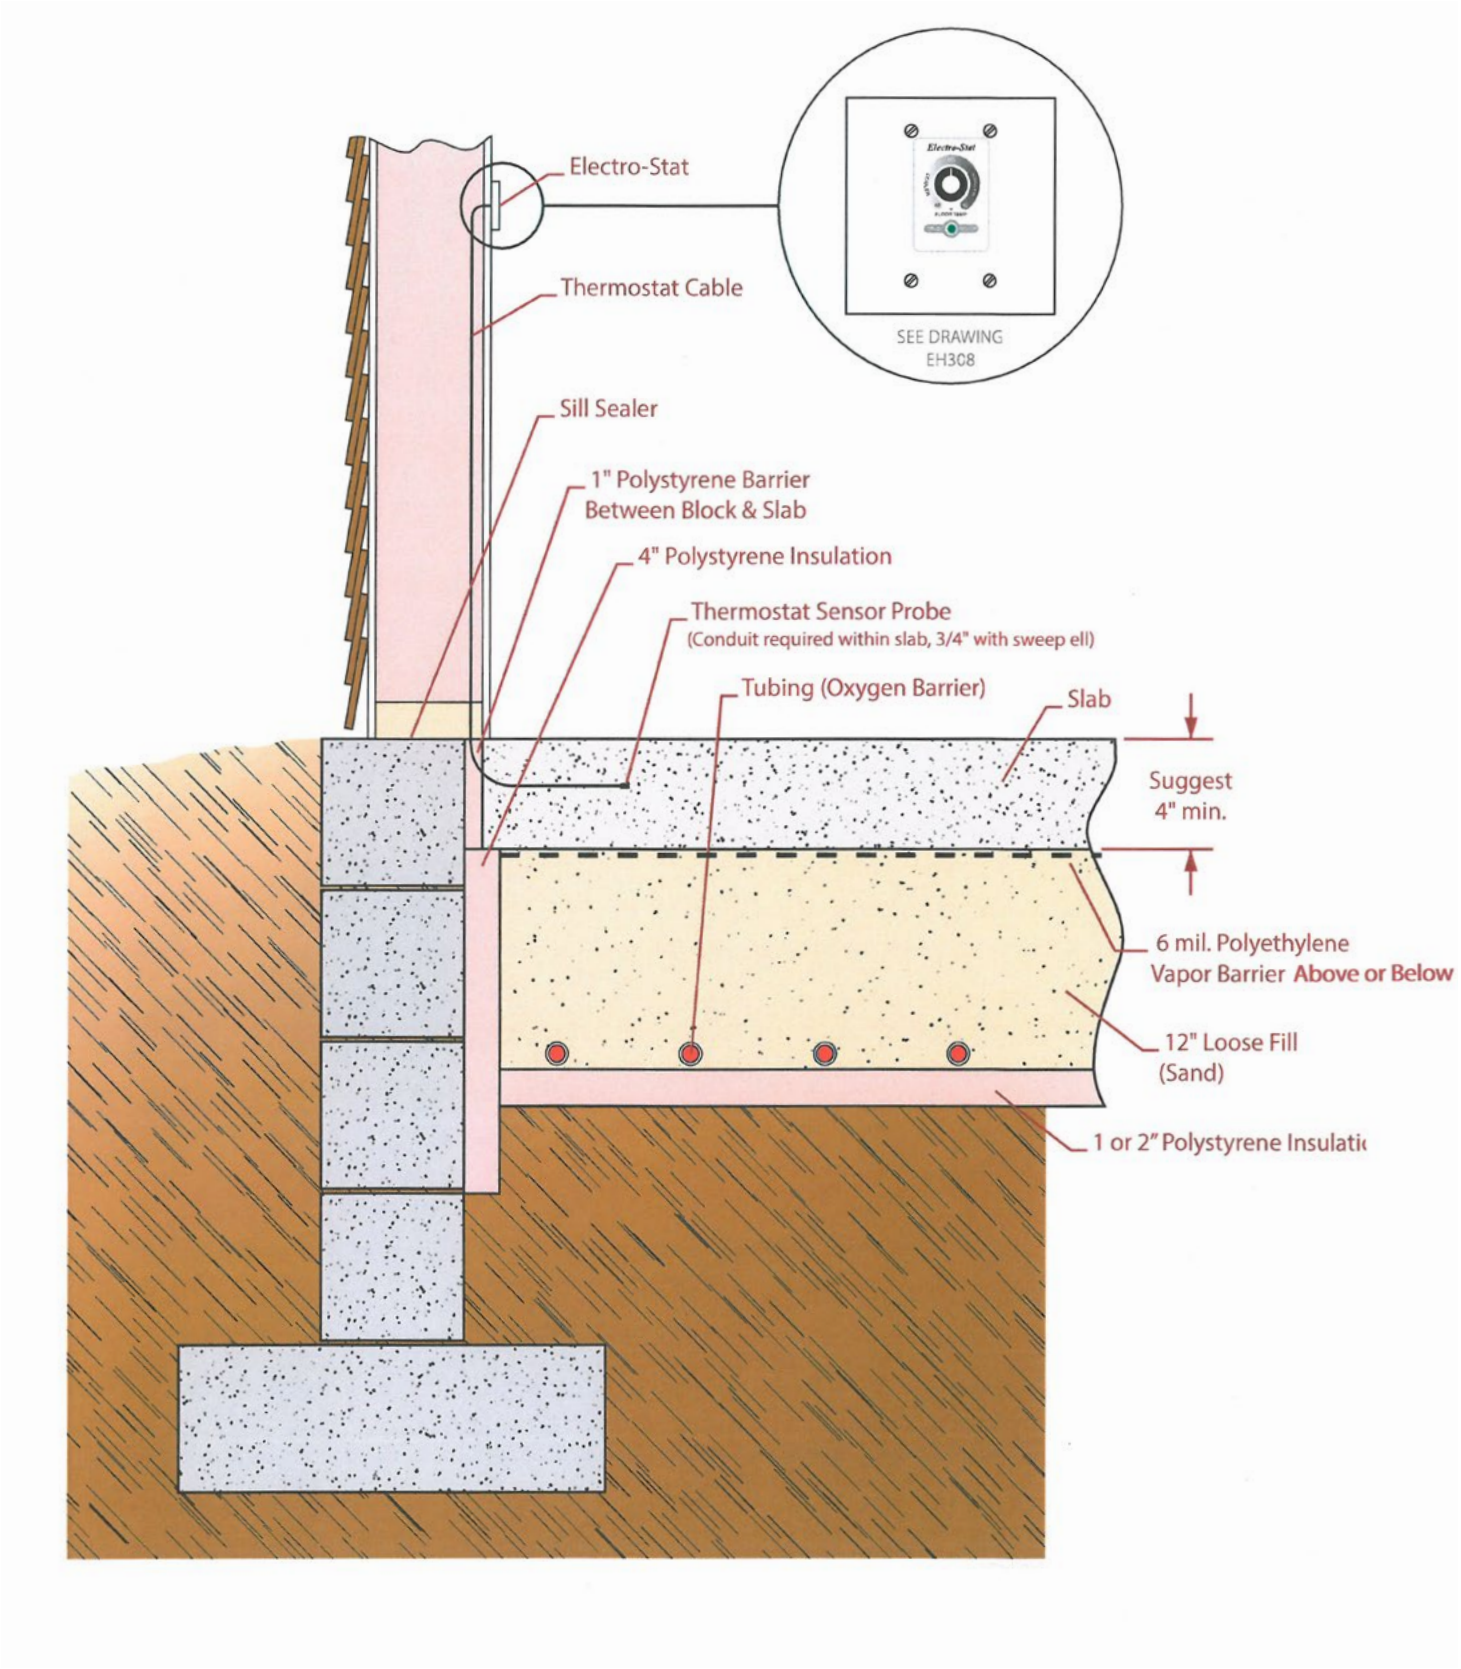
ETS Storage – 14 to 20 hour