


NOTES:

- The protective equipment that is installed must either isolate the Main Service Panel or trip to prevent islanding of the generation system with the EPS.
- All circuit interrupting devices shall have poles for all ungrounded circuit conductors.
- A main disconnect is recommended. A main disconnect may be required to meet the requirements that the generator have an accessible visible disconnect.
- Refer to Article 100 of the NEC for definition of “readily accessible” and “in sight”.

ITEM	QTY.	DESCRIPTION	PARALLEL GENERATOR INTERCONNECTDION FOR COGENERATION AND SMALL POWER PRODUCTION	
			SEPTEMBER, 2020	M8-20

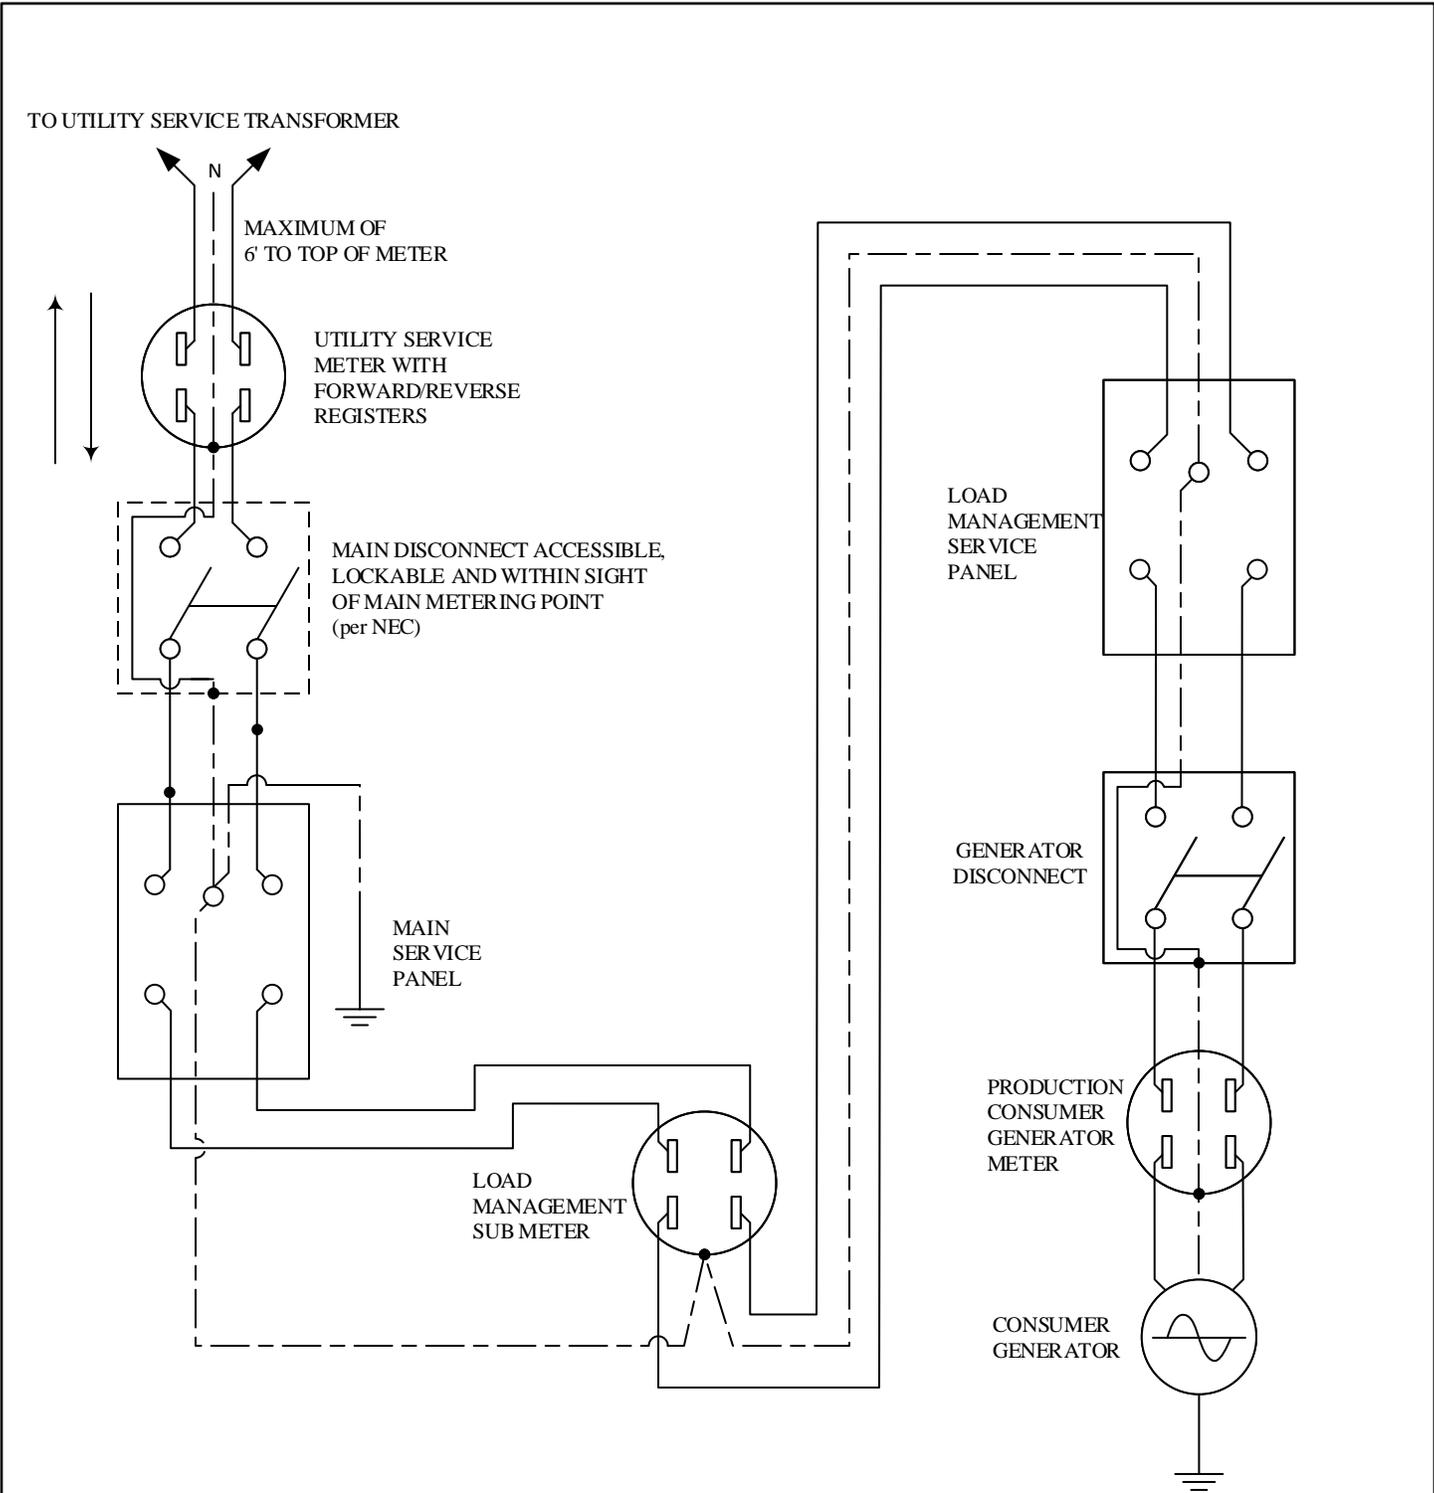

NOTES:

- The protective equipment that is installed must either isolate the Main Service Panel or trip to prevent islanding of the generation system with the EPS.
- All circuit interrupting devices shall have poles for all ungrounded circuit conductors.
- A main disconnect is recommended. A main disconnect may be required to meet the requirements that the generator have an accessible visible disconnect.
- Refer to Article 100 of the NEC for definition of "readily accessible" and "in sight".

ITEM	QTY.	DESCRIPTION	PARALLEL GENERATOR INTERCONNECTION FOR COGENERATION AND SMALL POWER PRODUCTION WITH SUB METERED LOAD MANAGEMENT	
			SEPTEMBER, 2020	M8-21